



Outdoor Installation

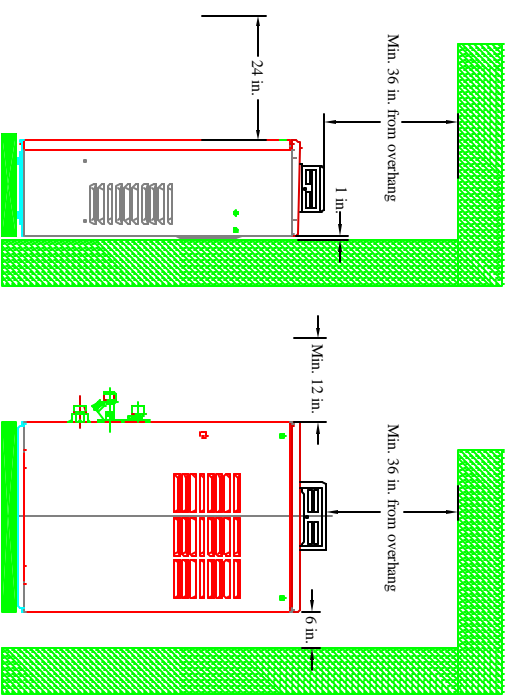

Indoor Installation

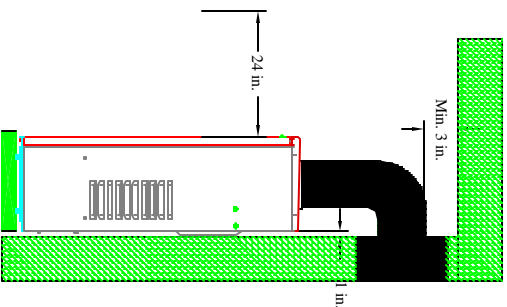

Minimum recommended Air Supply to Water Heater

Outside Air Area	Inside Air Area
47 Sq. In. Each	185 Sq. In. Each

Diameter	Max. No. of Elbows	Max. Vertical and Horizontal run in Length
4 In.	3	35 Ft.

Deduct 5 ft. from max. length for each added 90 degree elbow

Note: All dimensions are not proportional

